


WELL CONSTRUCTOR'S REPORT TO WISCONSIN STATE BOARD OF HEALTH
See Instructions on Reverse Side

1. County Crawford Co. Town
Village Prairie du Chien, Wisc.
City Check one and give name
2. Location 216 North Prairie
Name of street and number of premise or Section, Town and Range numbers
3. Owner or Agent 3. M. Company
Name of individual, partnership or firm
4. Mail Address 216 North Prairie
Complete address required
5. From well to nearest: Building 10 ft; sewer ft; drain ft; septic tank ft;
 dry well or filter bed ft; abandoned well 25 ft.
6. Well is intended to supply water for: Process Water Perm Well # 42801

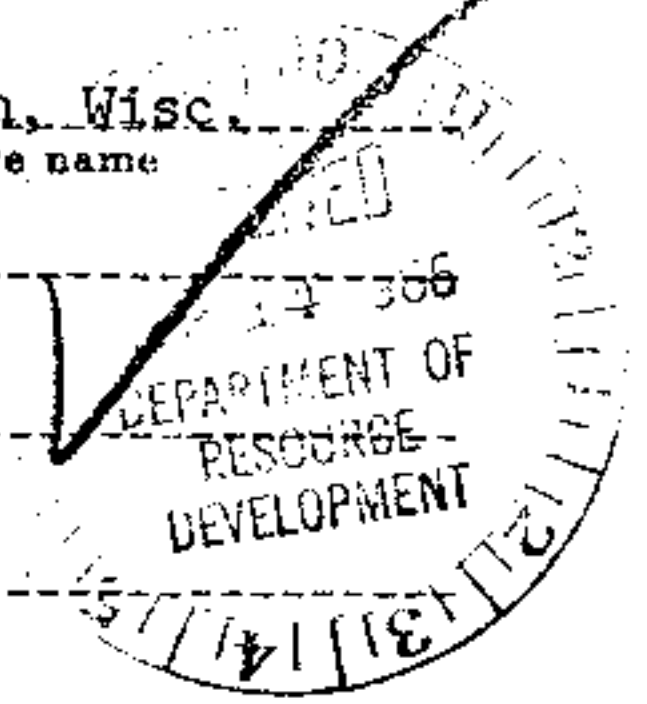

7. DRILLHOLE:

Dia. (in.)	From (ft.)	To (ft.)	Dia. (in.)	From (ft.)	To (ft.)
42"	0	70'			

8. CASING AND LINER PIPE OR CURBING:

Dia. (in.)	Kind and Weight	From (ft.)	To (ft.)
16"	Steel .375" wall	+ 2'	50'
16"	S.S. Screen	50'	70'

9. GROUT:

Kind	From (ft.)	To (ft.)
Cement Grout	0	45
Clay Seal	45	48

11. MISCELLANEOUS DATA:

Yield test: 24 Hrs. at 600 GPM.
 Depth from surface to water-level: 21 ft.
 Water-level when pumping: 26 1/2 ft.
 Water sample was sent to the state laboratory at:
Madison on August 10 1966
City

10. FORMATIONS:

Kind	From (ft.)	To (ft.)
Sand & Gravel	0	70'

Construction of the well was completed on:
August 10 1966

The well is terminated 18 inches
 above, below the permanent ground surface.

Was the well disinfected upon completion?
 Yes No

Was the well sealed watertight upon completion?
 Yes No

Signature W030 VARNER Well Pump Co WPAW Selwyn
Registered Well Driller PO Box 237 Dubuque Iowa
Please do not write in space below Complete Mail Address

Rec'd. No.
 Ans'd
 Interpretation High Capacity Well Approved 7-18-66
File: Prairie du Chien
Crawford Co. # 1 (Ind.)

10 ml 10 ml 10 ml 10 ml 10 ml
 Gas—24 hrs. CC; M.E. Ostrom
 48 hrs. 9/15/66
 Confirm
 B. Coli
 Examiner